


RS-485 Modbus RTU
 Temperature
 Humidity Sensor Transmitter
 For PLC and DCS Room
 Thermocouple Monitoring



PRODUCT PARAMATER

Basic Parameter

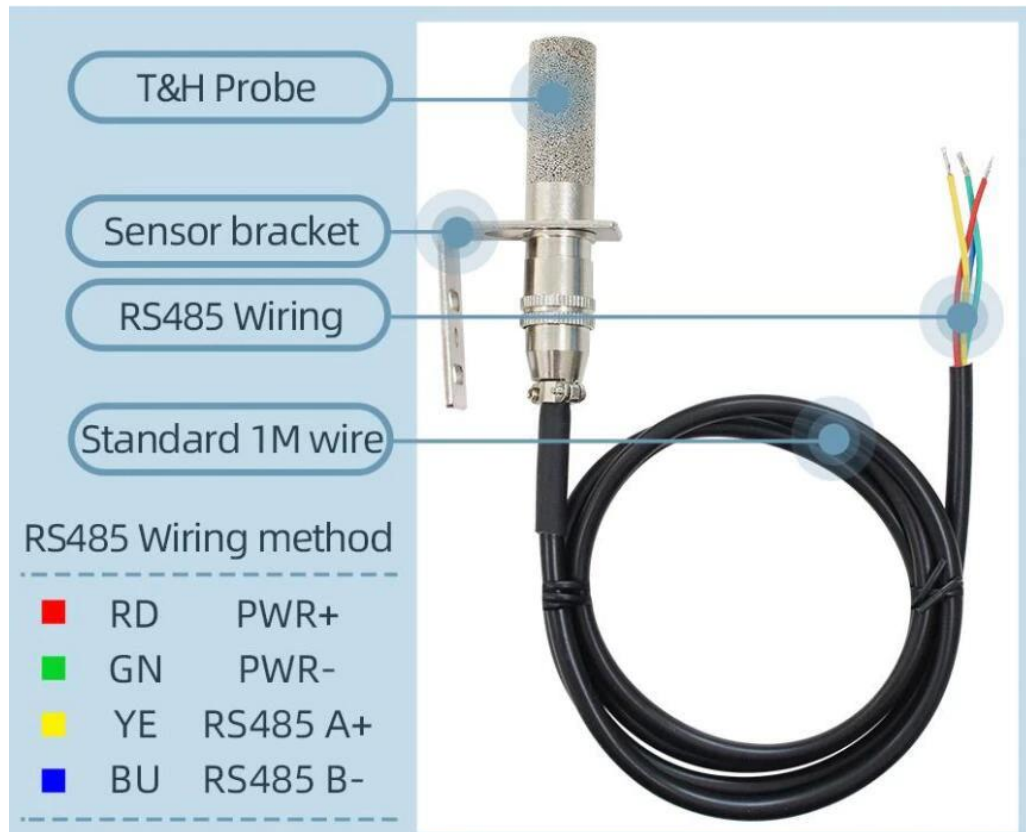

- Temperature measuring range $-30^{\circ}\text{C}\sim 80^{\circ}\text{C}$
- Temperature measuring accuracy $\pm 0.5^{\circ}\text{C}$ @ 25°C
- Humidity measuring range $0\sim 100\%\text{RH}$
- Humidity accuracy $\pm 3\%\text{RH}$ @ 25°C
- Communication Interface RS485
- Default baud rate 9600 8 n 1
- Power DC6~24V 1A
- Running temperature $-40\sim 80^{\circ}\text{C}$
- Working humidity $5\%\text{RH}\sim 90\%\text{RH}$